

Certificate of Compliance

Certificate: 1986492

Master Contract: 241965

Project: 1986492

Date Issued: December 5, 2007


Issued to: BEKA associates Ltd.
Old Charlton Rd
Hitchin, Hertfordshire SG5 2DA
United Kingdom

Attention: Chris Burkitt

*The products listed below are eligible to bear the CSA Mark shown
with adjacent indicators 'C' and 'US'*



Issued by: K. Atkins

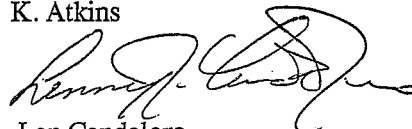

Authorized by: Len Candeloro
Product Group Manager

PRODUCTS

CLASS 4418 02 - Outlet Boxes and Fittings for Hazardous Locations

CLASS 4418 82 - Outlet Boxes and Fittings for Hazardous Locations - Certified to US Standards

Class I, Groups A, B, C and D; Class II, Groups E, F and G; Class III; Type 4X, IP66

Explosion-proof enclosures, BR323SS Instrument Housing, cast 316 stainless steel, with glass or solid cover, three 1/2" or 3/4" NPT conduit entries. Optional 2" stainless steel pipe-mount hardware kit P.

Certificate: 1986492

Project: 1986492



Master Contract: 241965

Date Issued: December 5, 2007

APPLICABLE REQUIREMENTS

- | | |
|----------------------------|---|
| C22.2 No. 25-1966 | - Enclosures for Use in Class II, Groups E, F and G Hazardous Locations |
| C22.2 No. 30-M1986 | - Explosion-Proof Enclosures for Use in Class I Hazardous Locations |
| CAN/CSA-C22.2 No. 94-M91 | - Special Purpose Enclosures |
| FM 3600-1998 | - Electrical Equipment for Use in Hazardous (Classified) Locations. General Requirements. |
| FM 3615-1989 | - Explosion-proof Electrical Equipment |
| ANSI/NEMA 250-1991 | - Enclosures for Electrical Equipment |
| CAN/CSA-C22.2 No. 60529:05 | - Degrees of protection provided by enclosures (IP Code) |

MARKINGS

The manufacturer's metal ID label/tag is mechanically attached to the exterior of the housing base. Label (ID Tag) drawing 200-251-2256B:

- Company's name, trademark, or the CSA Master Contract number 241965 (adjacent to the CSA C_US Mark).
- Series / Model designation.
- Date code / Serial number traceable to month and year of manufacture.
- Hazardous Location designations, Class I, Groups A, B, C, D; Class II, Groups E, F, G; Class III; CSA Enclosure Type 4X.
- IP66
- The CSA "C_US" Mark.
- The following cautions or equivalent:
 - "CAUTION: OPEN CIRCUIT BEFORE REMOVING COVER" or, "CAUTION: KEEP COVERS TIGHT WHILE CIRCUITS ARE ALIVE"